


RLC-201

MON-9600

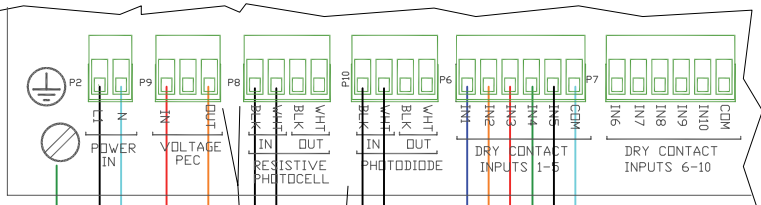


BEACON
ALARM

MARKER
ALARM


FLASHER
FAIL ALARM

BACKUP
ALARM / NIGHT
MODE

POWER FAIL
ALARM

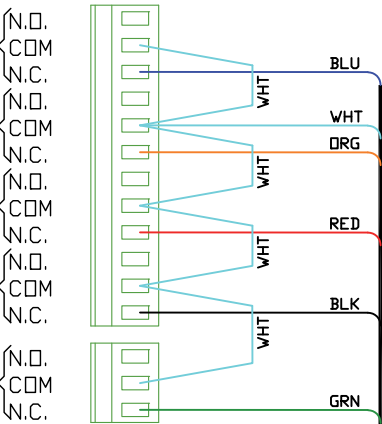

CABLE 2

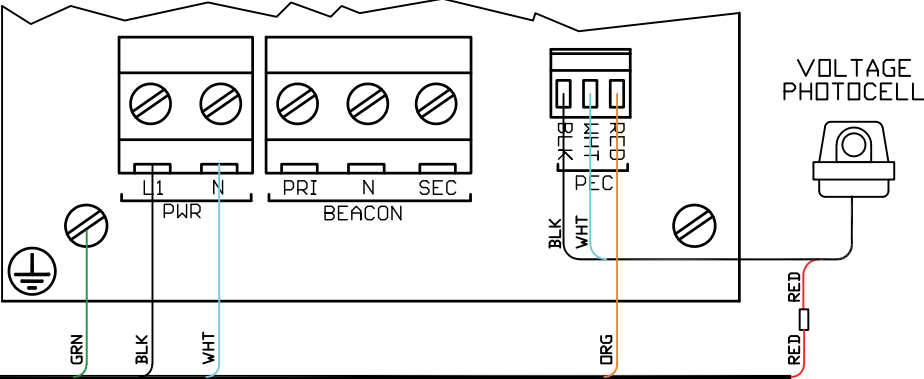

NOTE: VERIFY P8/P9/P10 WIRING BEFORE CONNECTING
LIGHTING SYSTEM. VERIFY MON-9600 FUSE F2 IS INSTALLED.

NOTICE

The drawing, information, and subject matter hereof are the exclusive, sole, and confidential property of International Tower Lighting, LLC and may not be copied, reproduced, or used in any manner for any purpose whatsoever without written consent or direction from International Tower Lighting, LLC .

1	4/4/2019	ADDED BLK -WIRE FOR DRY CONTACT INPUT (P6), ADDED WIRING TO PEC	EHI	RG
REV	DATE	DESCRIPTION	REVISED BY	APPROVED
1001 Centre Pointe Drive, Suite A La Vergne, TN 37086, USA Tel.+1 615-256-6030 Fax +1 615-256-6032 www.itl-llc.com				
DRAWN EHI	10/31/2018			
CHECKED JCR	10/31/2018			
QA				
MFG				
APPROVED		TITLE WIRING DIAGRAM MON-9600 TO RLC-201		
PLOT DATE	4 / 4 / 19			
FILENAME DOC-MON-9600-WD-RLC-201 R1.DWG	SCALE	SIZE B	DWG NO DOC-MON-9600-WD-RLC-201	REV 1
		SHEET 1		