


CIP300TWR

MON-9600

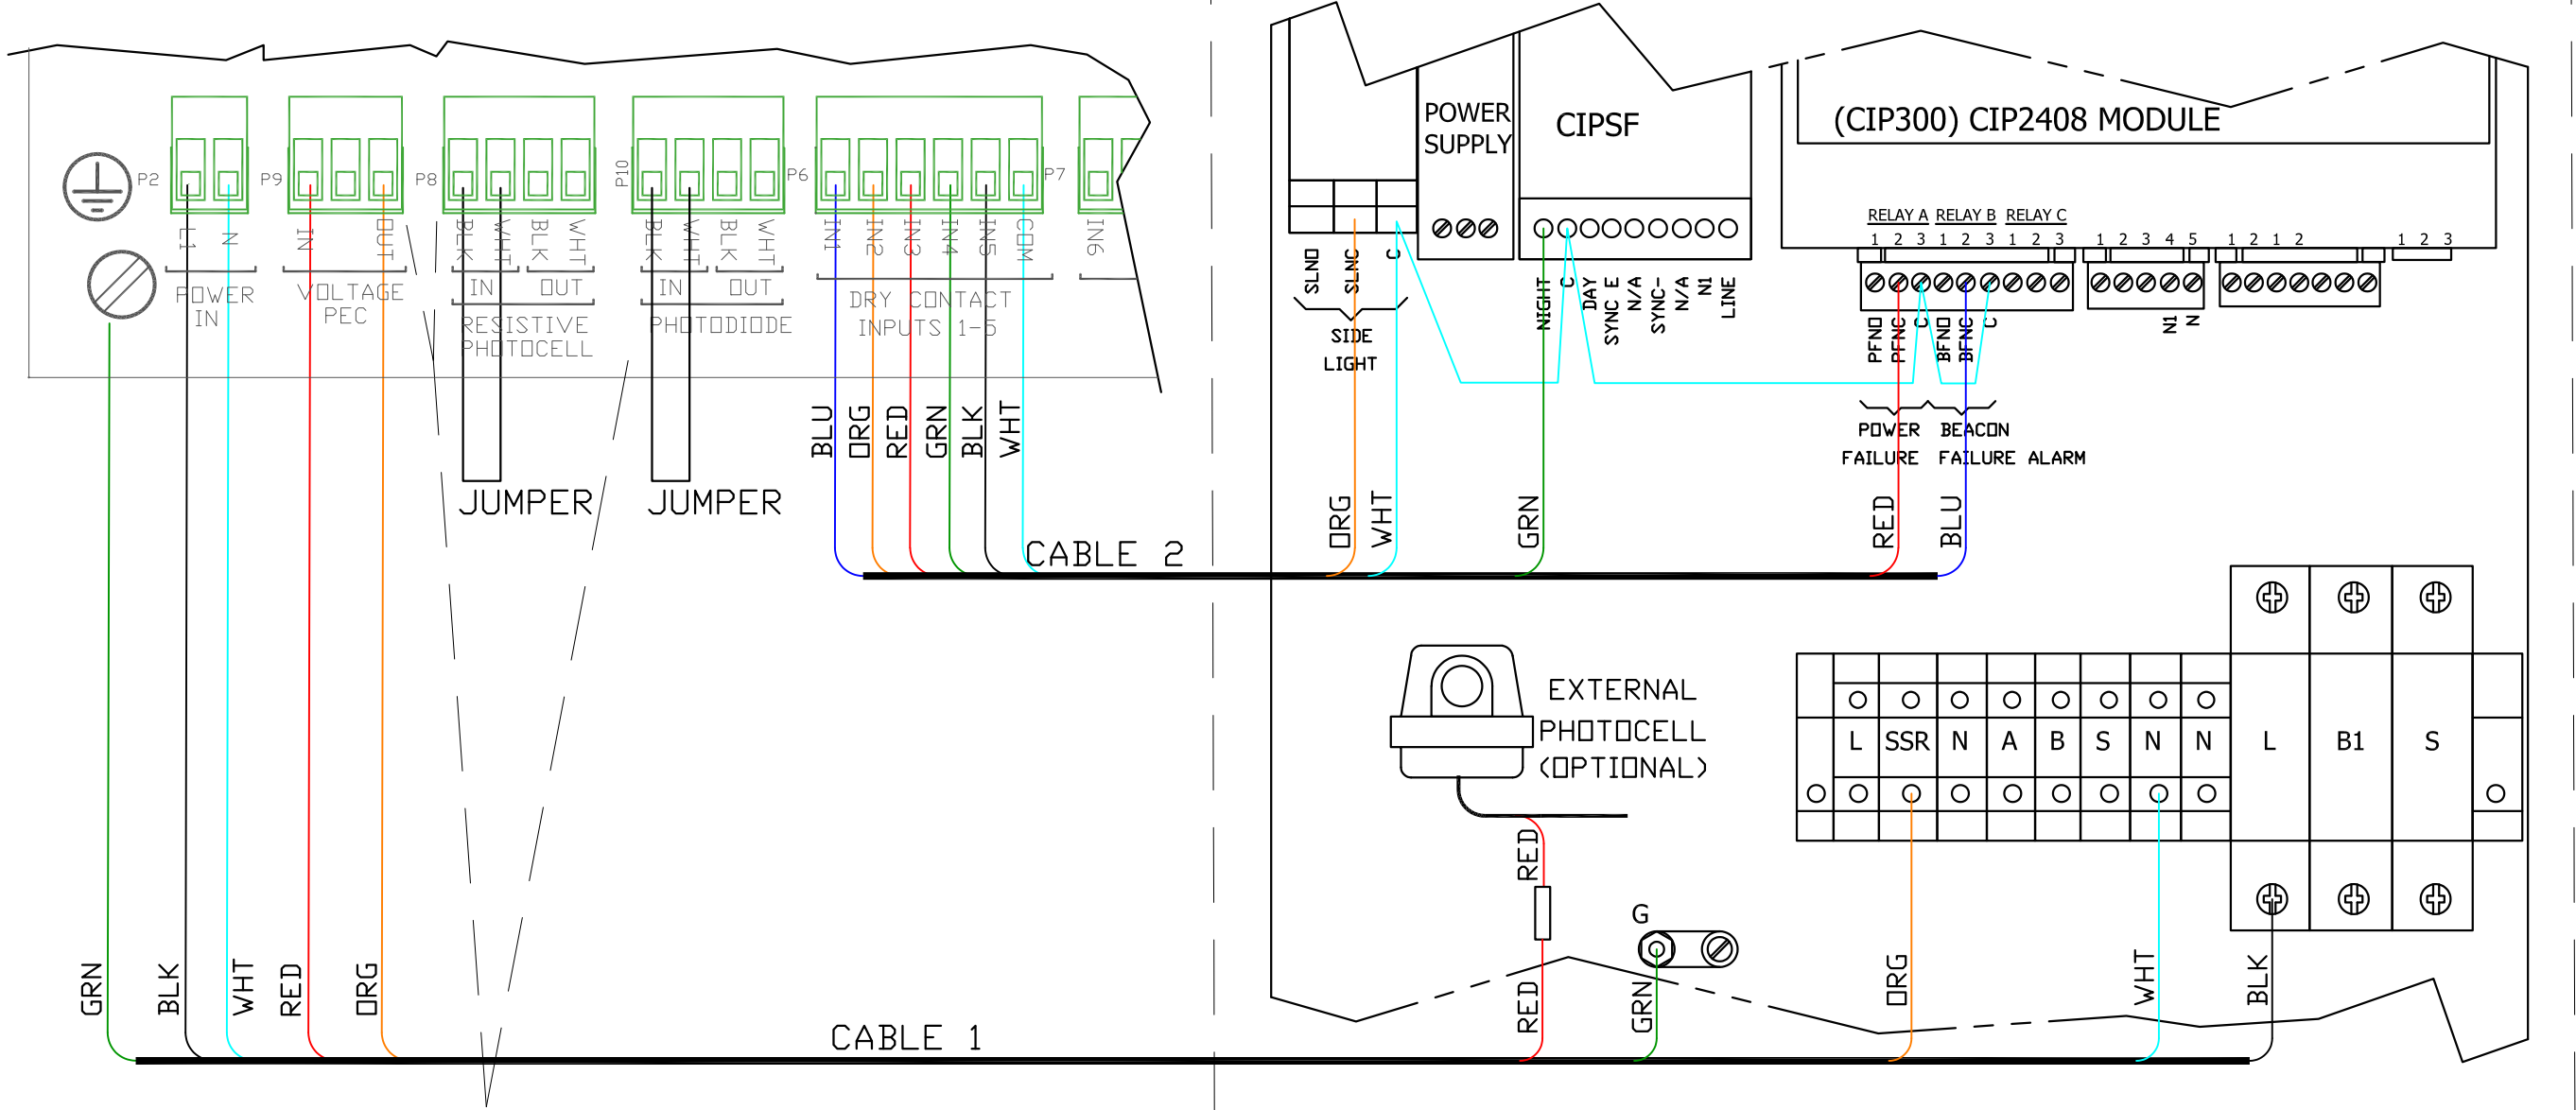

NOTE: VERIFY P8/P9/P10 WIRING BEFORE CONNECTING LIGHTING SYSTEM.
CONNECT PHOTOCELL WIRING AS SHOWN IF EXTERNAL PHOTOCELL OPTIONAL RELAY K1 IS INSTALLED.
IF K1 IS NOT INSTALLED DO NOT CONNECT PHOTOCELL WIRING AND DO NOT INSTALL FUSE F2.

NOTICE

The drawing, information, and subject matter hereof are the exclusive, sole, and confidential property of International Tower Lighting, LLC and may not be copied, reproduced, or used in any manner for any purpose whatsoever without written consent or direction from International Tower Lighting, LLC .

1	8/21/2020	ADDED NOTE FOR EXTERNAL PHOTOCELL.	EHI	RG
REV	DATE	DESCRIPTION	REVISED BY	APPROVED
1001 Centre Pointe Drive, Suite A La Vergne, TN 37086, USA Tel.+1 615-256-6030 Fax +1 615-256-6032 www.itl-llc.com				
DRAWN EHI	11/1/2018			
CHECKED JCR	11/1/2018			
QA				
MFG				
APPROVED		TITLE WIRING DIAGRAM MON-9600 TO CIP300TWR		
PLOT DATE	8/21/20			
FILENAME DOC-MON-9600-WD-CIP300 R1.DWG				
SIZE B	DWG NO DOC-MON-9600-WD-CIP300	REV 1	SHEET 1	