


CIP300TWR

MON-G960

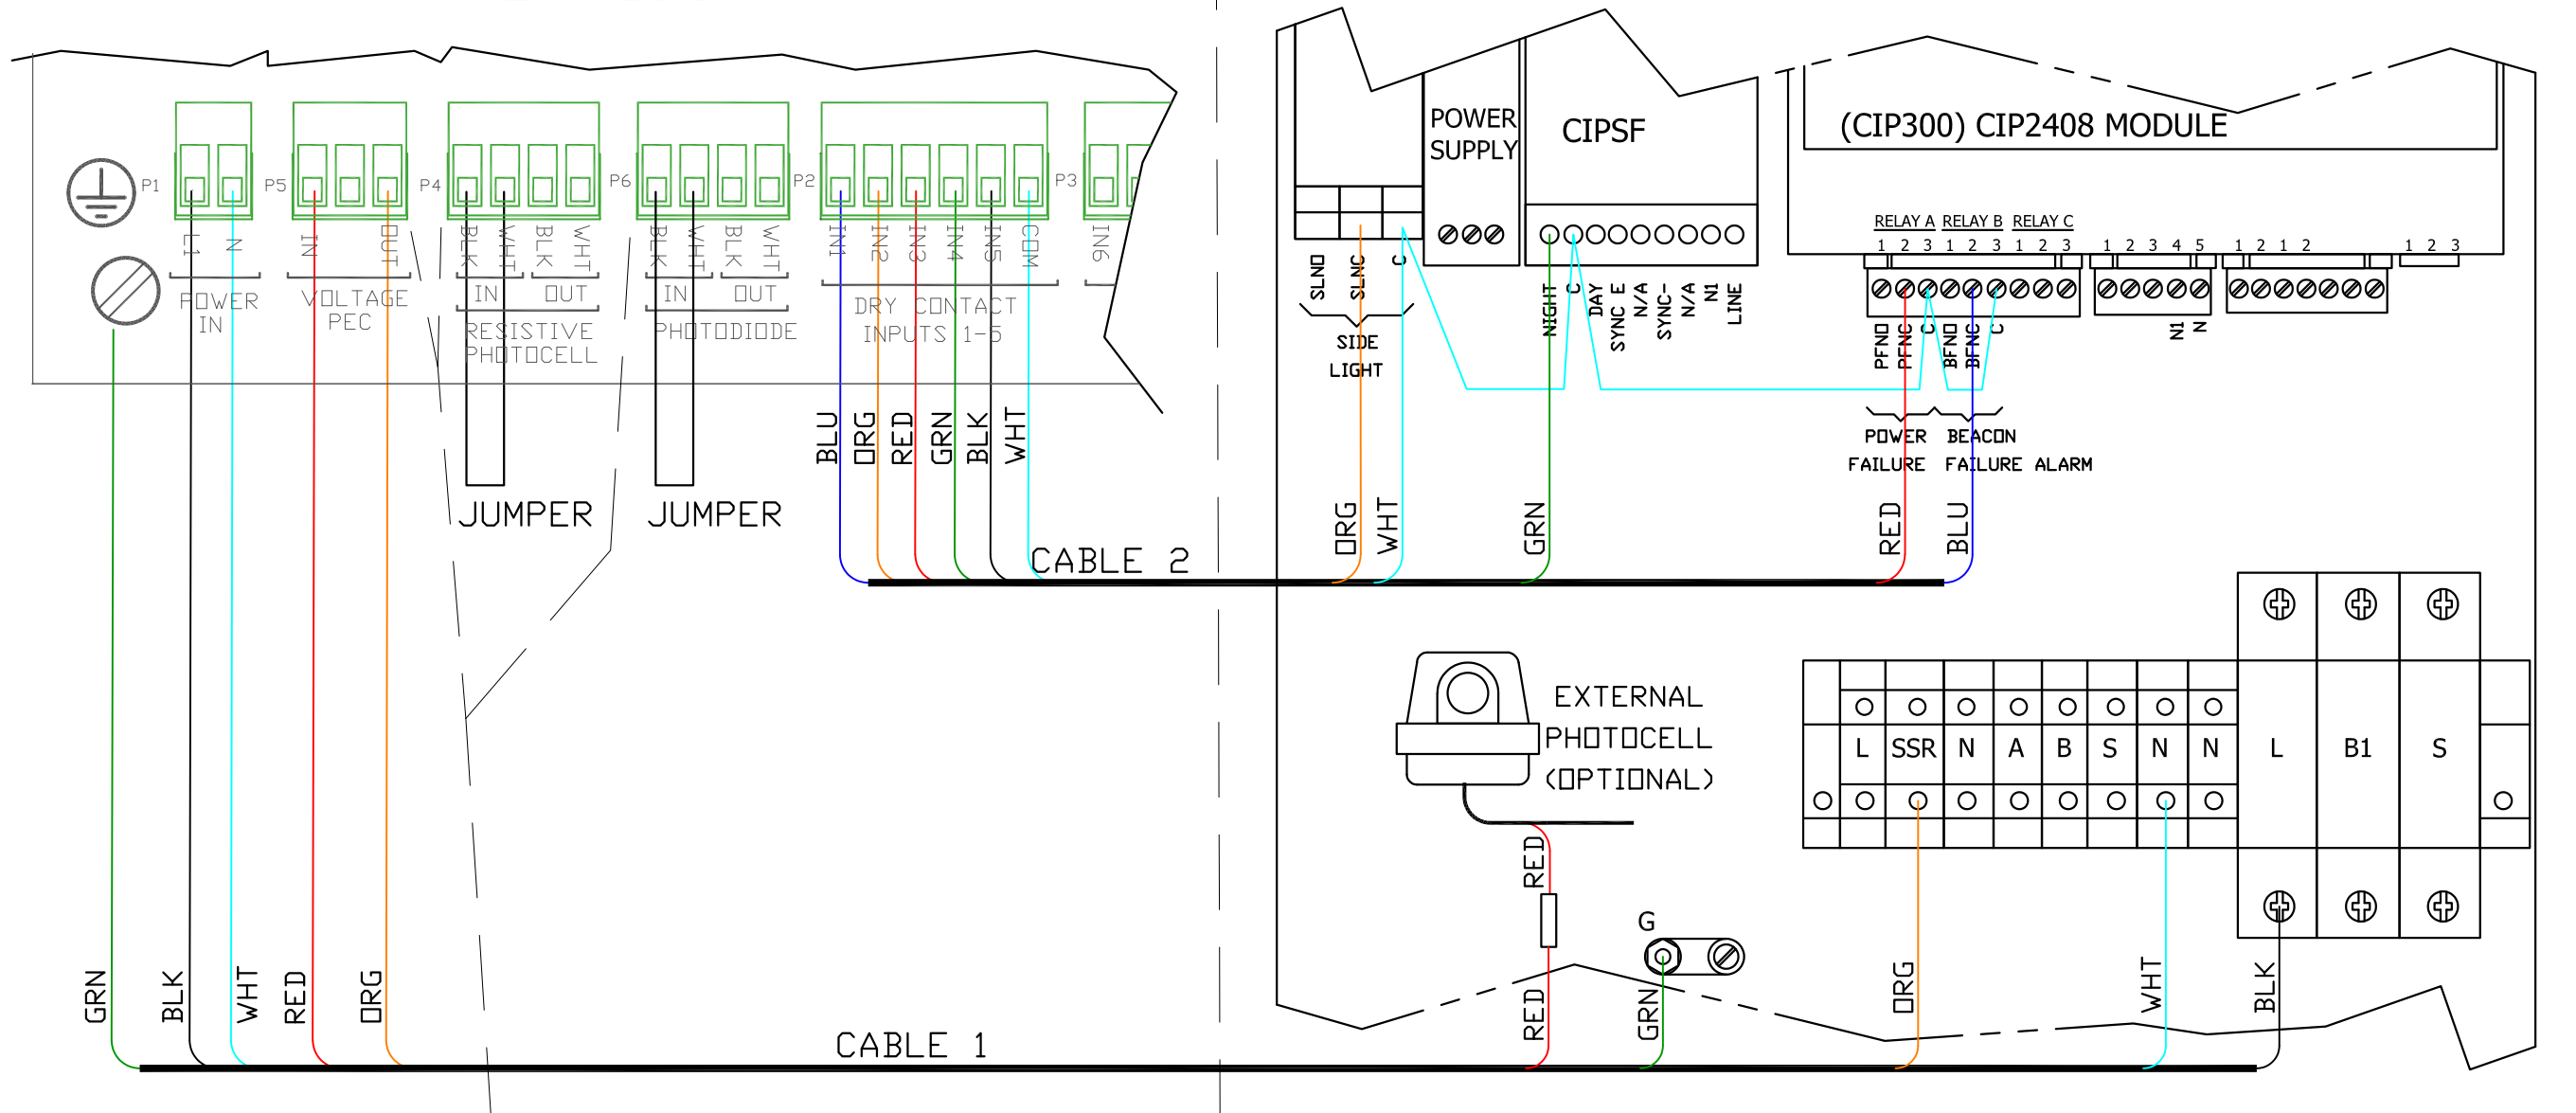

NOTE: VERIFY P4/P5/P6 WIRING BEFORE
CONNECTING LIGHTING SYSTEM.
CONNECT PHOTOCELL WIRING AS SHOWN IF
EXTERNAL PHOTOCELL OPTIONAL RELAY K1
IS INSTALLED.
IF K1 IS NOT INSTALLED DO NOT CONNECT
PHOTOCELL WIRING AND DO NOT INSTALL FUSE F2.

NOTICE

The drawing, information, and subject matter hereof are the exclusive, sole, and confidential property of International Tower Lighting, LLC and may not be copied, reproduced, or used in any manner for any purpose whatsoever without written consent or direction from International Tower Lighting, LLC .

1	8/21/2020	ADDED NOTE FOR EXTERNAL PHOTOCCELL.		EHI	RG	
REV	DATE	DESCRIPTION			REVISED BY	APPROVED
1001 Centre Pointe Drive, Suite A La Vergne, TN 37086, USA Tel.+1 615-256-6030 Fax +1 615-256-6032 www.itl-llc.com						
DRAWN EHI	5/9/2019					
CHECKED AI	5/9/2019					
QA						
MFG						
APPROVED		TITLE WIRING DIAGRAM MON-G960 TO CIP300TWR				
PLOT DATE	8/24/20					
FILENAME DOC-MON-G960-WD-CIP300 R1.DWG	SCALE					
		SHEET				



WIRING DIAGRAM

MON-G960 TO CIP300TWR